

# Plug-in timers 8 A



Drying kilns



Industrial  
furnaces and  
ovens



Industrial  
washing  
machines



Hoists and  
cranes



Wood-  
processing  
machines



Medical and  
dentistry



**88**  
SERIES



### Multi-voltage and multi-function timer range

#### Front panel or socket mount

- 8 and 11 pin plug-in versions available
- Time scales from 0.05 s to 100 h
- "1 delayed contact + 1 instantaneous contact" version available (type 88.12)
- Front panel mounting fixing included
- 90 series sockets

### 88.02



- Multi-function
- 11 pin
- Plug-in for use with 90 series sockets

**AI:** On-delay

**DI:** Interval

**GI:** Pulse delayed


**SP:** Symmetrical flasher (starting pulse off) without control signal



**BE:** Off-delay with control signal

**CEa:** On- and off-delay with control signal

**DE:** Interval with control signal on



P = Pause  
S = Start  
R = Reset

For outline drawing see page 5

### 88.12



- Multi-function
- 8 pin, 2 timed contacts or 1 timed + 1 instantaneous contact
- Plug-in for use with 90 series sockets

**AI a:** On-delay (2 timed contacts)

**AI b:** On-delay (1 timed + 1 instantaneous contact)



**DI a:** Interval (2 timed contacts)

**DI b:** Interval (1 timed + 1 instantaneous contact)

**GI:** Pulse delayed

**SW:** Symmetrical flasher (starting pulse on)

without control signal



### Contact specification

Contact configuration	2 CO (DPDT)	2 CO (DPDT)
Rated current/Maximum peak current	A 8/15	8/15
Rated voltage/Maximum switching voltage	V AC 250/400	250/400
Rated load AC1	VA 2000	2000
Rated load AC15 (230 V AC)	VA 400	400
Single phase motor rating (230 V AC)	kW 0.3	0.3
Breaking capacity DC1: 24/110/220 V	A 8/0.3/0.12	8/0.3/0.12
Minimum switching load	mW (V/mA) 300 (5/5)	300 (5/5)
Standard contact material	AgNi	AgNi

### Supply specification

Nominal voltage (U <sub>N</sub> )	V AC (50/60 Hz)	24...230	24...230
	V DC	24...230	24...230
Rated power AC/DC	VA (50 Hz)/W	2.5 (230 V)/1 (24 V)	2.5 (230 V)/1.5 (24 V)
Operating range	V AC	20.4...264.5	20.4...264.5
	V DC	20.4...264.5	20.4...264.5

### Technical data

Specified time range	(0.05 s...5 h) - (0.05 s...10 h) - (0.05 s...50 h) - (0.05 s...100 h)
Repeatability	% ± 1
Recovery time	ms 300
Minimum control impulse	ms 50
Setting accuracy-full range	% ± 3
Electrical life at rated load AC1	cycles 100 · 10 <sup>3</sup>
Ambient temperature range	°C -10...+55
Protection category	IP 40

Approvals (according to type)



**Multi-voltage and mono-function timer range**  
**Front panel or socket mount**


- Asymmetrical flasher The ON and OFF time are independently adjustable
- 8 pin plug-in
- Time scales from 0.05 s to 300 h
- 2 contacts
- Front panel mounting fixing included
- 90 series sockets

**88.92 - 0000**

- Mono-function
- 8 pin, 2 timed contacts
- Plug-in for use with 90 series sockets

**PI:** Asymmetrical flasher (starting pulse OFF)


without control signal

**88.92 - 0001**

- Mono-function
- 8 pin, 2 timed contacts
- Plug-in for use with 90 series sockets

**LI:** Asymmetrical flasher (starting pulse ON)

without control signal



For outline drawing see page 5

**Contact specification**

Contact configuration		2 CO (DPDT)	2 CO (DPDT)
Rated current/Maximum peak current	A	8/15	8/15
Rated voltage/ Maximum switching voltage	V AC	250/400	250/400
Rated load AC1	VA	2000	2000
Rated load AC15 (230 V AC)	VA	400	400
Single phase motor rating (230 V AC)	kW	0.3	0.3
Breaking capacity DC1: 24/110/220 V	A	8/0.3/0.12	8/0.3/0.12
Minimum switching load	mW (V/mA)	300 (5/5)	300 (5/5)
Standard contact material		AgNi	AgNi

**Supply specification**

Nominal voltage (U <sub>N</sub> )	V AC (50/60 Hz)	12...240	12...240
	V DC	12...240	12...240
Rated power AC/DC	VA (50 Hz)/W	2.5 (230 V)/1.5 (24 V)	2.5 (230 V)/1.5 (24 V)
Operating range	V AC	10.8...264.5	10.8...264.5
	V DC	10.8...264.5	10.8...264.5

**Technical data**

Specified time range		See "Time Scale" page 6	See "Time Scale" page 6
Repeatability	%	± 1	± 1
Recovery time	ms	200	200
Minimum control impulse	ms	—	—
Setting accuracy-full range	%	± 1	± 1
Electrical life at rated load AC1	cycles	100 · 10 <sup>3</sup>	100 · 10 <sup>3</sup>
Ambient temperature range	°C	-10...+55	-10...+55
Protection category		IP 40	IP 40

**Approvals** (according to type)

### Ordering information

Example: 88 series multi-function timer, 2 CO (DPDT) 8 A contacts, (24...230)V AC (50/60 Hz) and (24...230)V DC supply.

<p><b>Series</b></p> <p><b>Type</b></p> <p>0 = Functions AI, DI, GI, SP, BE, CEa, DE, 11 pin</p> <p>1 = Functions AI a, AI b, DI a, DI b, GI, SW, 8 pin</p> <p>9 = Functions LI, PI, 8 pin</p> <p><b>No. of poles</b></p> <p>2 = 2 pole</p> <p><b>Supply version</b></p> <p>0 = AC (50/60 Hz)/DC</p>	<p><b>Special versions</b></p> <p>0 = Functions PI (starting pulse OFF) for 88.92</p> <p>1 = Functions LI (starting pulse ON) for 88.92</p> <p>2 = Standard</p> <p><b>Supply voltage</b></p> <p>230 = (24...230)V AC/DC for 88.02, 88.12</p> <p>240 = (12...240)V AC/DC for 88.92</p> <p><b>Codes</b></p> <p>88.02.0.230.0002</p> <p>88.12.0.230.0002</p> <p>88.92.0.240.0000</p> <p>88.92.0.240.0001</p>
--	---

### Technical data

#### EMC specifications


Type of test		Reference standard	88.02/88.12	88.92
Electrostatic discharge	contact discharge	EN 61000-4-2	4 kV	4 kV
	air discharge	EN 61000-4-2	8 kV	6 kV
Radio-frequency electromagnetic field (80 ÷ 1000 MHz)		EN 61000-4-3	10 V/m	10 V/m
Fast transients (burst) (5-50 ns, 5 kHz) on Supply terminals		EN 61000-4-4	2 kV	—
Surges (1.2/50 µs) on Supply terminals	common mode	EN 61000-4-5	2 kV	—
	differential mode	EN 61000-4-5	1 kV	—
Radio-frequency common mode (0.15 ÷ 80 MHz) on Supply terminals		EN 61000-4-6	3 V	—

#### Other data


Power lost to the environment	without contact current W	3.4
	with rated current W	4.7

### Outline drawings

Types 88.02/12

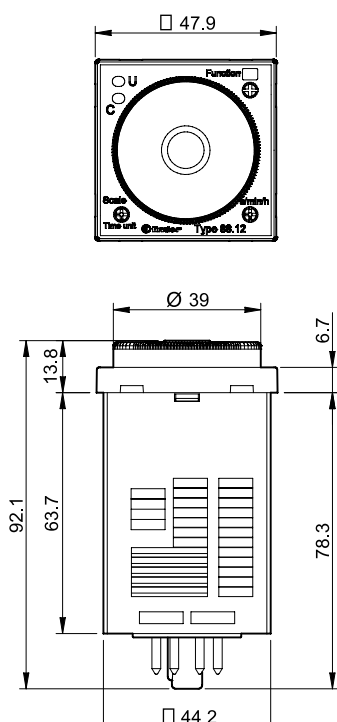

Type 88.92

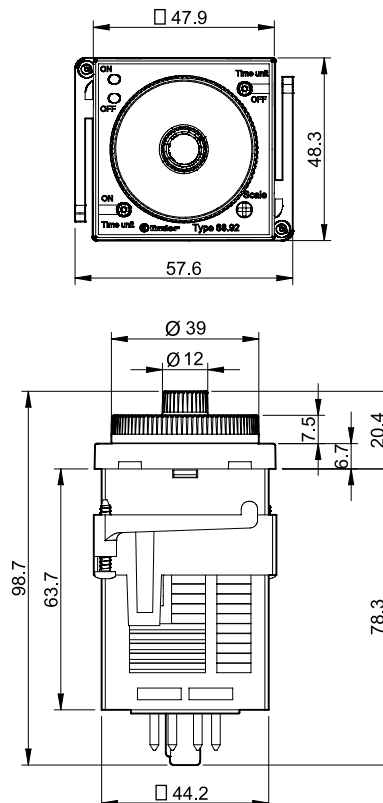

## Selection of: function, time scale and units


	88.02	88.12	88.92 - 0000	88.92 - 0001
Function	AI, DI, GI, SP, BE, CEa, DE	AI a, AI b, DI a, DI b, GI, SW	PI	LI
Time scale	0.5, 1, 5, 10		1.2, 3, 12, 30	
Unit of time	s (second), min (minute), h (hour), 10 h (10 hours)		s (second), 10 s (second x 10), min (minute), 10 min (minute x 10), h (hour), 10 h (hour x 10)	

## Time scales

## Full scale value for types 88.02, 88.12

D \ H	s	min	h	10 h
0.5	0.5 second	0.5 minute	0.5 hour	5 hour
1	1 second	1 minute	1 hour	10 hour
5	5 second	5 minute	5 hour	50 hour
10	10 second	10 minute	10 hour	100 hour


## Types 88.02, 88.12

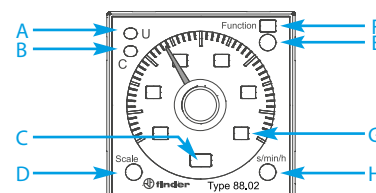

## Full scale value for type 88.92

H \ D-E	s	10 s	min	10 min	h	10 h
1.2	1.2 second	12 second	1.2 minute	12 minute	1.2 hour	12 hour
3	3 second	30 second	3 minute	30 minute	3 hour	30 hour
12	12 second	120 second	12 minute	120 minute	12 hour	120 hour
30	30 second	300 second	30 minute	300 minute	30 hour	300 hour

## Type 88.92

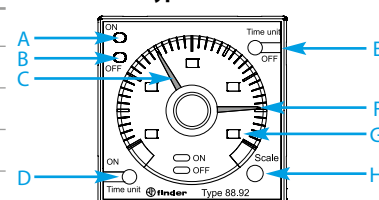

NOTE: time scales and functions must be set before energising the timer.

## LED/visual indication

## Types 88.02, 88.12

A	Yellow LED: power ON (U)
B	Red LED: timing in progress (C)
C	Unit of time selected
D	Time scale selector
E	Function selector
F	Function selected
G	Time scale selected
H	Unit of time selector

## Type 88.92

A	Red LED: pulse ON (T1)
B	Green LED: pulse OFF (T2)
C	Red timing regulator: T1 time setting
D	Unit of time selector: T1 (ON)
E	Unit of time selector: T2 (OFF)
F	Green timing regulator: T2 time setting
G	Time scale selected
H	Time scale selector


## Functions for types 88.02, 88.12

	LED (yellow)	LED (red)	Supply voltage	NO output contact	Contact	
					Open	Closed
<b>U</b> = Supply Voltage			OFF	Open	x1 - x4	x1 - x2
<b>S</b> = Signal switch			ON	Open	x1 - x4 x1 - x2	x1 - x2 x1 - x4
<b>P</b> = Pause			ON	Open (timing in progress)	x1 - x4	x1 - x2
<b>R</b> = Reset			ON	Closed	x1 - x2	x1 - x4

### Wiring diagram


#### Type 88.02

without control signal



#### (AI) On-delay.

Apply power to timer. Output contacts transfer after preset time has elapsed. Reset occurs when power is removed.




#### (DI) Interval.

Apply power to timer. Output contacts transfer immediately. After the preset time has elapsed, contacts reset.



#### (GI) Pulse delayed.



Apply power to timer. Output contacts transfer after preset time has elapsed. Reset occurs after a fixed time of 0.5 s.



#### (SP) Symmetrical flasher (starting pulse off).


Apply power to timer. First transfer of contact occurs after preset time has elapsed. The timer now cycles between OFF and ON as long as power is applied. The ratio is 1:1 (time on = time off).

with control signal

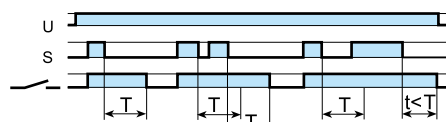


#### (BE) Off-delay with control signal.

Power is permanently applied to the timer. The output contacts transfer immediately on closure of the Signal Switch (S). Opening the Signal Switch initiates the preset delay, after which time the output contacts reset.

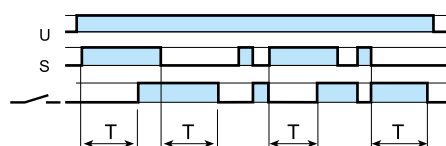

#### (CEa) On- and off-delay with control signal.

Power is permanently applied to the timer. Closing the Signal Switch (S) initiates the preset delay, after which time the output contacts transfer. Opening the Signal switch initiates the same preset delay, after which time the output contacts reset.

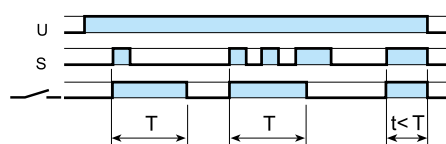

#### (DE) Interval with control signal on.

Power is permanently applied to the timer. On momentary or maintained closure of Signal Switch (S), the output contacts transfer, and remain so for the duration of the preset delay, after which they reset.

### RESET (R)

A momentary closure of the reset switch (2-7) will reset the timer. Longer term closure of the reset switch will hold the timer in the reset state. This is applicable for all functions.

### PAUSE (P)

Closure of the pause switch (2-5) will immediately halt the timing process, but the elapsed time will be retained, and the current state of the output contacts will be maintained.



On opening of the pause switch, timing resumes from the retained value. This is applicable for all functions.

## Functions for type 88.12

## Wiring diagram

## Type 88.12


without control signal

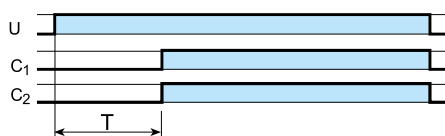**(AI a) On-delay (2 timed contacts).**


Apply power to timer.

Contacts (C<sub>1</sub> and C<sub>2</sub>) transfer after preset time has elapsed.

Reset occurs when power is removed.

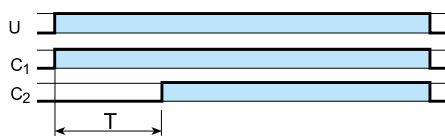**(AI b) On-delay****(1 timed contact + 1 instantaneous contact).**Apply power to timer. Output contact (C<sub>1</sub>) transfers immediately.Contact (C<sub>2</sub>) transfers after the preset time has elapsed.



Reset occurs when power is removed.

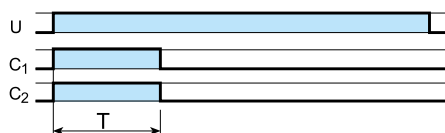**(DI a) Interval (2 timed contacts).**

Apply power to timer.

Output contacts (C<sub>1</sub> and C<sub>2</sub>) transfer immediately.

After preset time has elapsed, the contacts reset.

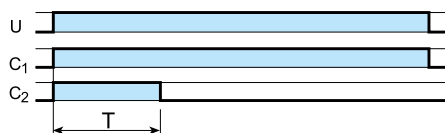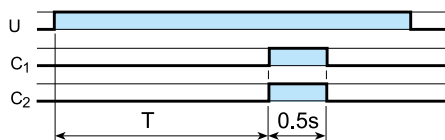**(DI b) Interval (1 timed contact + 1 instantaneous contact).**Apply power to timer. Output contacts (C<sub>1</sub> and C<sub>2</sub>) transfer immediately. After preset time has elapsed, the contact (C<sub>2</sub>) resets.Contact (C<sub>1</sub>) resets when power is removed.**(GI) Pulse delayed.**

Apply power to timer. Output contacts transfer after preset time has elapsed. Reset occurs after a fixed time of 0.5 s.

**(SW) Symmetrical flasher (starting pulse on).**

Apply power to timer. Output contacts transfer immediately and cycle between ON and OFF for as long as power is applied.

The ratio is 1:1 (time on = time off).

## Functions for type 88.92



U = Supply  
Voltage

LED ON (red)	LED OFF (green)	Supply voltage	Contact	
			Open	Closed
_____	_____	OFF	11 - 14 21 - 24	11 - 12 21 - 22
	_____	ON	11 - 12 21 - 22	11 - 14 21 - 24
_____		ON	11 - 14 21 - 24	11 - 12 21 - 22


## Wiring diagram

## Type 88.92

without control signal

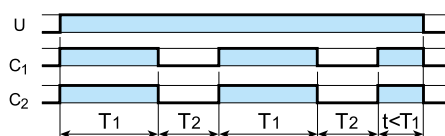**(LI) Asymmetrical flasher (starting pulse ON).**

Apply power to timer. Output contacts transfer immediately and cycle between ON and OFF for as long as power is applied. The ON and OFF times are independently adjustable.

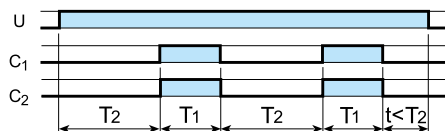**(PI) Asymmetrical flasher (starting pulse OFF).**Apply power to timer. Output contacts transfer after time T<sub>2</sub> has elapsed and cycle between OFF and ON for as long as power is applied. The ON and OFF times are independently adjustable.







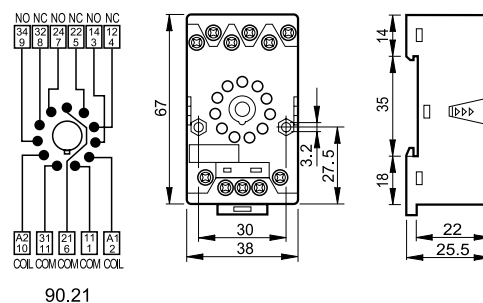
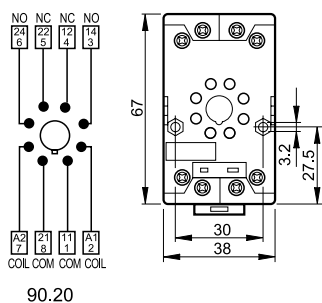
90.21

Approvals

(according to type):



Box clamp socket	90.20	90.20.0	90.21	90.21.0
panel or 35 mm rail (EN 60715) mount	Blue	Black	Blue	Black
For timer type	88.12, 88.92		88.02	
Technical data				
Rated values	10 A - 250 V			
Dielectric strength	2 kV AC			
Protection category	IP 20			
Ambient temperature	°C	−40...+70		
 Screw torque	Nm	0.5		
Wire strip length	mm	10		
Max. wire size for 90.20 and 90.21 sockets		solid wire		stranded wire
	mm²	1 x 6 / 2 x 2.5		1 x 6 / 2 x 2.5
	AWG	1 x 10 / 2 x 14		1 x 10 / 2 x 14




90.26

Approvals

(according to type):



Screw terminal (Plate clamp) socket panel or 35 mm rail (EN 60715) mount	90.26 Blue	90.26.0 Black	90.27 Blue	90.27.0 Black
For timer type	88.12, 88.92		88.02	
Technical data				
Rated values	10 A - 250 V			
Dielectric strength	2 kV AC			
Protection category	IP 20			
Ambient temperature	°C	−40...+70		
 Screw torque	Nm	0.8		
Wire strip length	mm	10		
Max. wire size for 90.26 and 90.27 sockets		solid wire		stranded wire
	mm²	1 x 4 / 2 x 2.5		1 x 4 / 2 x 2.5
	AWG	1 x 12 / 2 x 14		1 x 12 / 2 x 14

